


WIRING AND SWITCH DETAILS

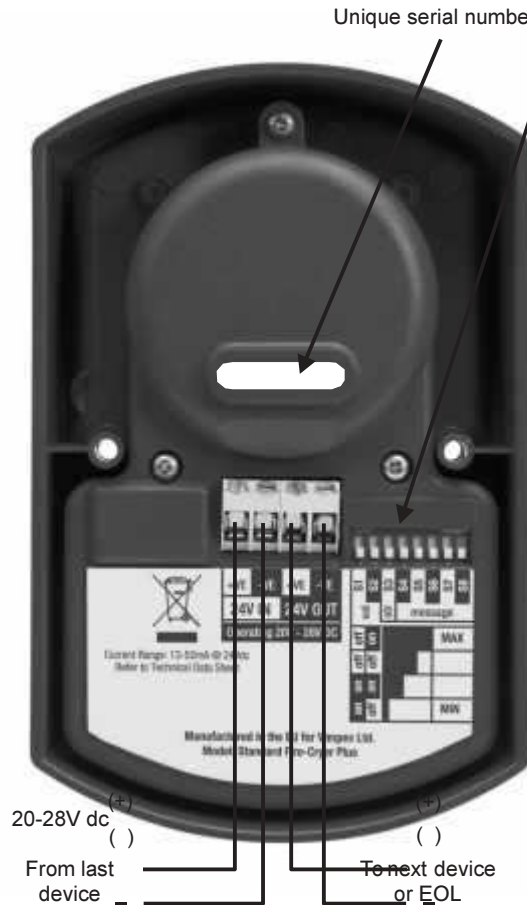

Unique serial number label

DIL switch for message and volume setting.

Switch ↑ UP-ON
Position ↓ DOWN-OFF

Volume Settings	SW1	SW2
0db (Max Volume)	OFF	ON
-6dB	OFF	OFF
-12dB	ON	ON
-18dB (Min Volume)	ON	OFF

Strobe (If fitted)	SW3
Normal Output	OFF
High Output	ON

Message Selection*	SW4	SW5	SW6	SW7
Multi-Message Use	OFF	OFF	OFF	OFF
Message 1	ON	OFF	OFF	OFF
Message 2	OFF	ON	OFF	OFF
Message 3	ON	ON	OFF	OFF
Message 4	OFF	OFF	ON	OFF
Message 5	ON	OFF	ON	OFF
Message 6	OFF	ON	ON	OFF
Message 7	ON	ON	ON	OFF

Note: SW8 is not used.

***Message Selection:**


For use in Multi-Message Mode with the MMSP (Multi-Message Switching PCB) select 'Multi Message Use' from the table above.

For Single Message Mode, use the table above to select one of the pre-stored messages - see overleaf for message list.

Installation:

Sounder unit is fitted to base with the two screws supplied.

OTHER FIRE-CRYER® PLUS PRODUCTS

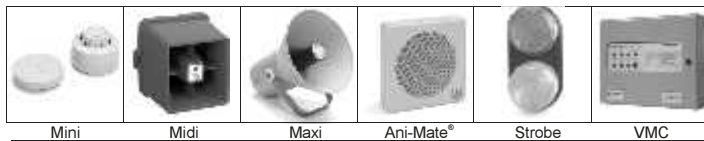

Vimpex Limited
Star Lane, Great Wakering
Essex SS3 0PJ England
Tel: +44 (0) 1702 216999
Fax: +44 (0) 1702 216699
E-mail: sales@vimpex.co.uk
www.vimpex.co.uk

VIMPEX

MESSAGE LIST

The Standard Message Set consists of 7 pre-programmed messages with tones (See Table A).

When used as a Multi Message Sounder the Multi Message Switching PCB will assign the messages to the following triggers:

	Starting Tone See table below†	Two Letter Message Code	Beacon Flashes*‡	Message Content	
Message 1	1		Y	Attention, attention. Fire has been detected in this area	S1A/ S1B
Message 2	2	AB	Y	Attention, attention. The secure perimeter at lower ground level has been compromised. Please send staff to investigate. Compromised. Please send staff to investigate.	MA
Message 3	2	MA	Y	Attention. Attention. The adjacent ward is evacuating their area. Compromised.	MB
Message 4	0	AD	N	This is a fire alarm test. No action required. No action required.	MC
Message 5	0	SP	N	Fire alert, fire alert. Would all available staff report to the ward office immediately	MD
Message 6	3	CC	N	Fire alert, fire alert. Would all available staff report to reception immediately	ME
Message 7	1	AF	Y	Attention. Attention. There is a fire alarm activation in this building	MF

*If Fitted

VIMPEX